


---

——2019

---




















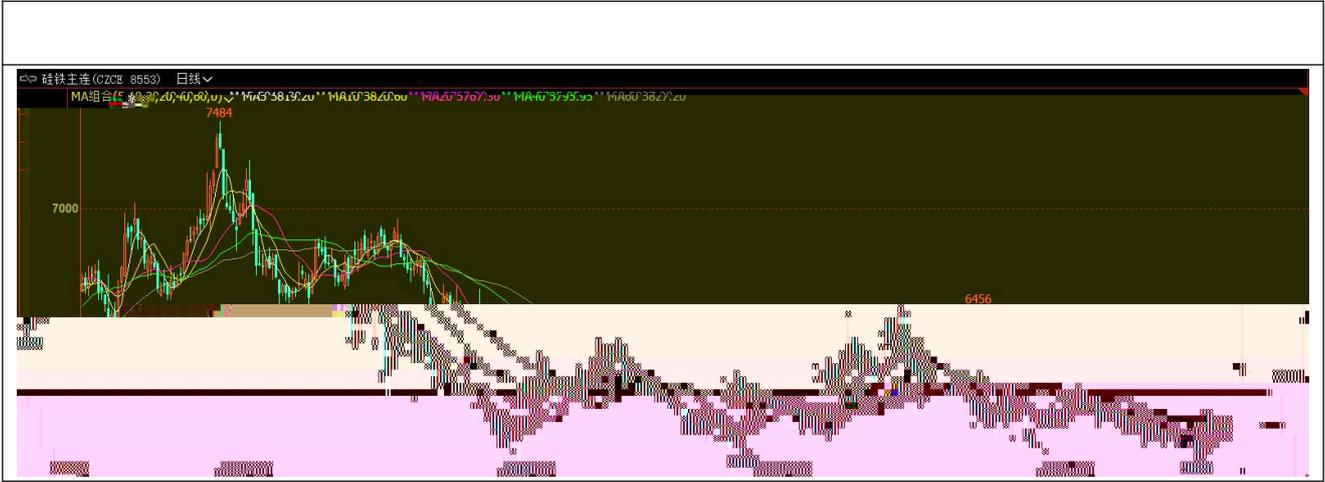


2019 10		2018 12	
	KVA)		KVA)
107	250.1 23373.83	100	234.1 23410
53	137.6 25962.26	58	132.45 22836.21
78	118.1 15141.03	63	88.55 14055.56
10	15.8 15800	14	20.98 14985.71
15	28.35 18900	9	20.13 22366.67
6	7.5 12500	7	10 14285.71
7	10 14285.71	5	8.75 17500
13	17.85 13730.77	11	16.95 15409.09
13	35.45 27269.23	10	27 27000
5	7.4 14800	4	6.6 16500
29	61.2 21103.45	27	39.9 14777.78
3	5.8 19333.33	10	13.3 13300
17	39.35 23147.06	16	34.5 21562.5
356	734.5 20632.02	334	653.21 19557.19


2018 12		2018 6			
		KVA)		KVA)	
100	234.1	23410	64	148.85	23257.81
58	132.45	22836.21	52	128	24615.38
63	88.55	14055.56	24	36.45	15187.5
14	20.98	14985.71	14	20.35	14535.71
9	20.13	22366.67	9	15.4	17111.11
7	10	14285.71	6	8.75	14583.33
5	8.75	17500	4	6.25	15625
11	16.95	15409.09	13	19.5	15000
10	27	27000	6	17.3	13307.69
4	6.6	16500	4	6.6	16500
27	39.9	14777.78	14	22.45	16035.71
10	13.3	13300	5	7.05	14100
16	34.5	21562.5	15	26.95	17966.67
334	653.21	19557.19	230	463.9	20169.57

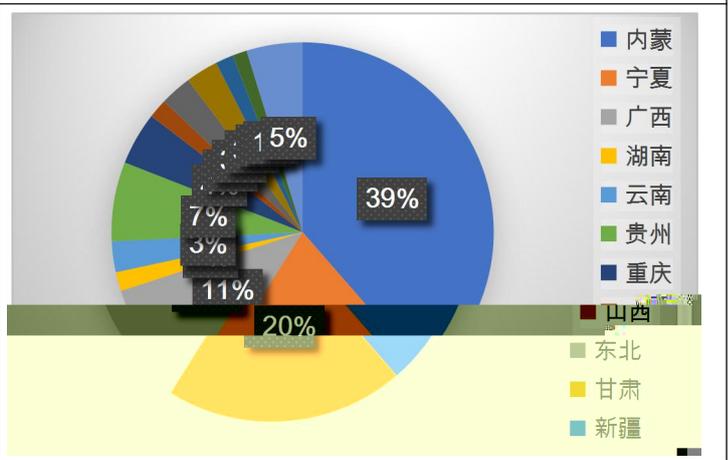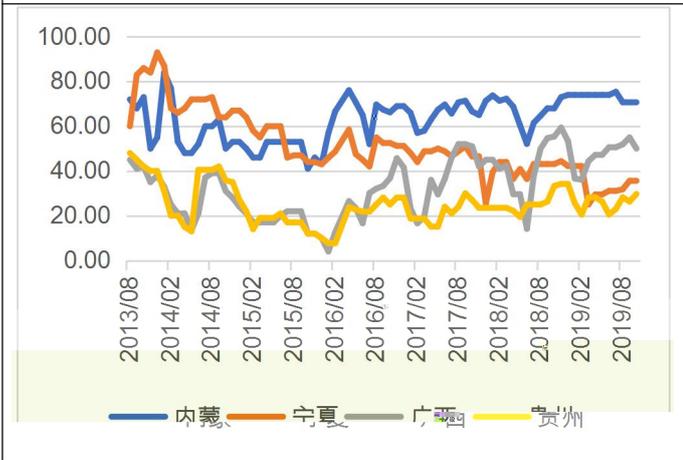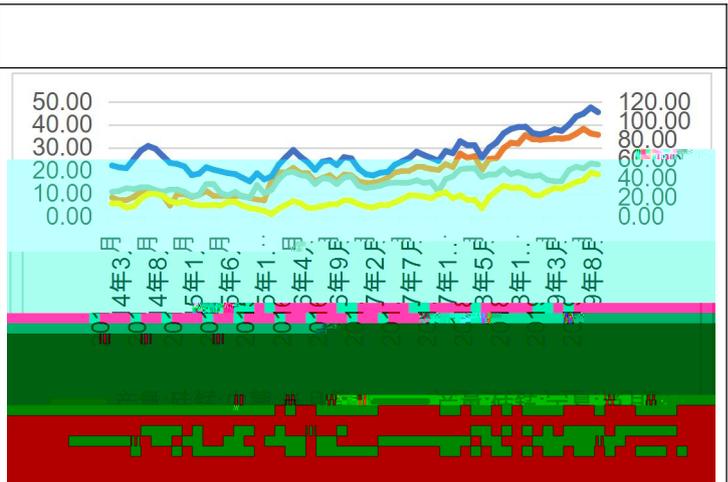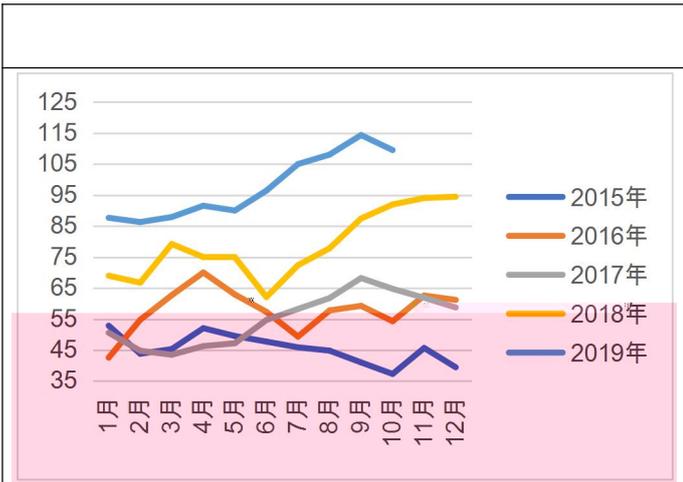



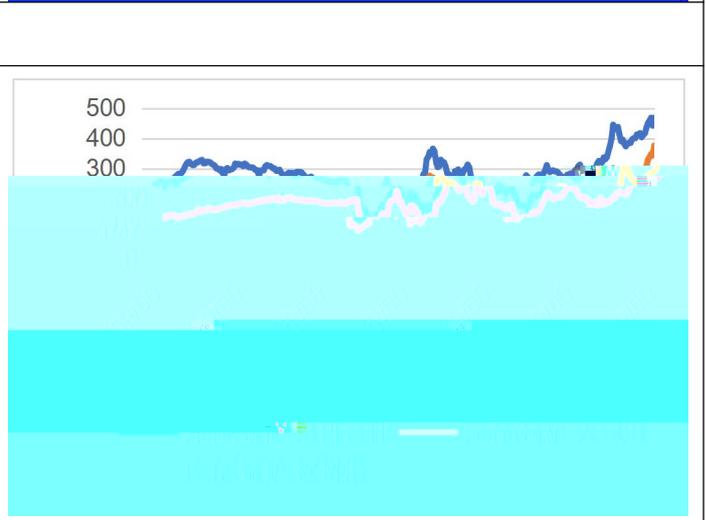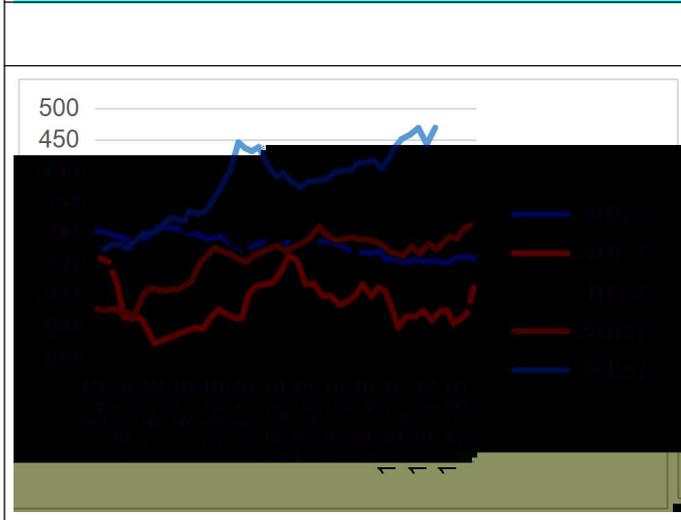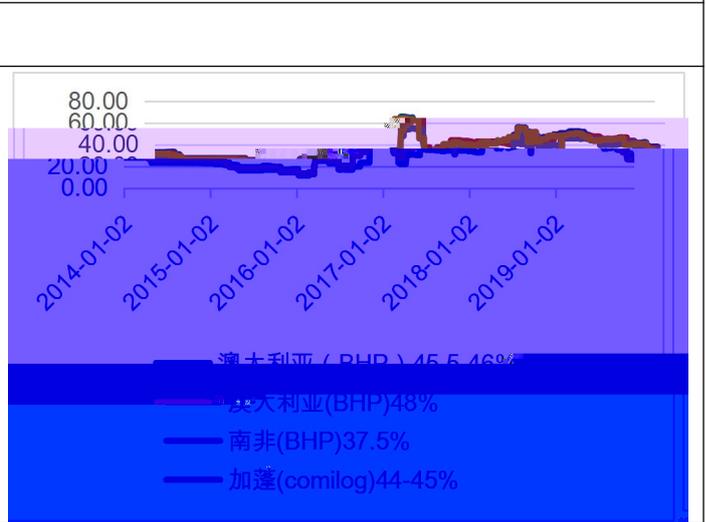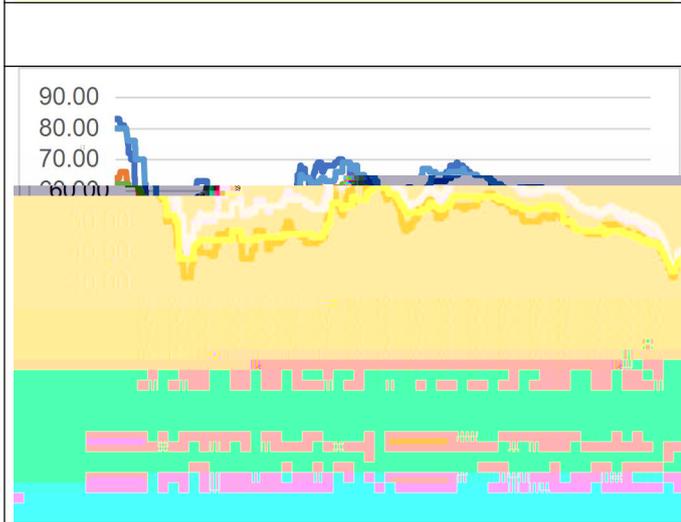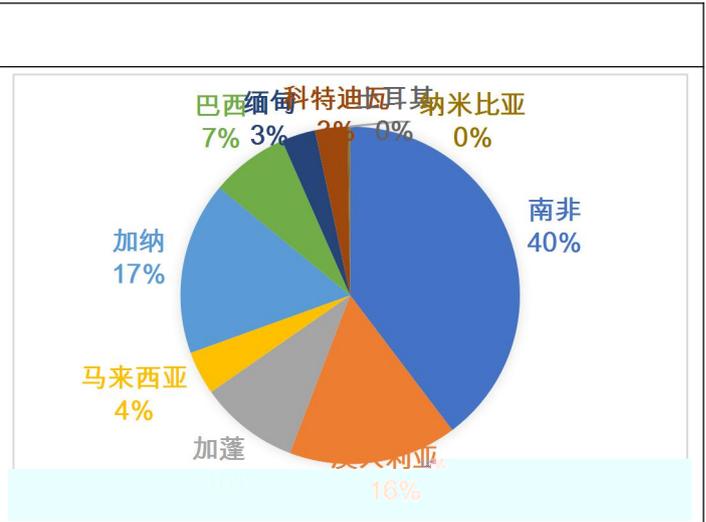



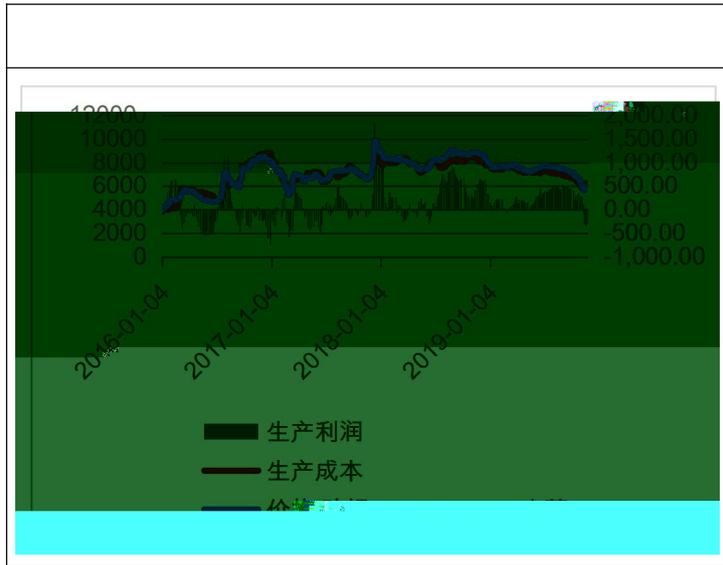

2019 10		2018 12			
124	223.5	18024.19	119	214.7	18042.02
77	136.4	17714.29	81	143.65	17734.57
42	85.55	20369.05	54	139.95	25916.67
40	59.12	14780	37	55.78	15075.68
283	504.57	17829.33	291	554.08	19040.55

